

SEE DRAWING W-19 FOR METER BOX INSTALLATION

MAINTAIN MIN. 1/4" PER FOOT RISE.

3" PVC SLEEVE


PEA GRAVEL BASE

MAINTAIN MIN. 1/4" PER FOOT RISE.

ITEM DESCRIPTION

- A SCREW ON BUG SCREEN
- B 1" DIAMETER PVC PIPE & UNION
- C ALL BRONZE SADDLE WITH DOUBLE STRAP
- D 1" CORP. STOP (MUELLER 300 SERIES, MCDONALD 4701BQ, OR EQUAL)
- E 1" BRONZE COMPRESSION JOINT
- F 1" BRONZE STREET ELL
- G 1" AIR RELEASE AND VACUUM RELIEF VALVE
- H 2' METER BOX - B-36 CHRISTY OR EQUAL
- I 1" BRONZE NIPPLE
- J ANGLE METER STOP COMPRESSION  
MUELLER 300 SERIES, MCDONALD 4602BT, OR EQUAL
- K 1" TYPE K COPPER TUBING, OR POLY

INSTALL TAP SADDLE ON TOP OF MAIN

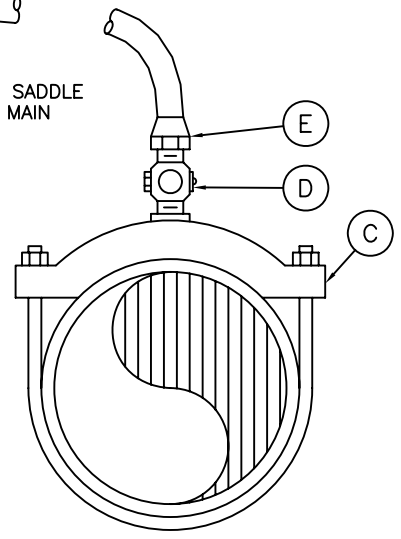

**NOTES:**

1. RECYCLED WATER AIR RELEASE & VACUUM RELIEF VALVE ASSEMBLIES SHALL BE IDENTIFIED AS RECYCLED WATER FACILITIES AS PER SPECIFICATION SECTION IV-B1-2.06.
2. FOR POTABLE WATER SYSTEMS, SEE DRAWING W-15.

REV. 05/06

Dublin San Ramon Services District	DATE 3/29/83
1" AIR RELEASE & VACUUM RELIEF VALVE INSTALLATION 6"-10" RECYCLED WATER MAINS	DESIGNED SRH
SIGNED COPY ON FILE AT DISTRICT OFFICE	DRAWING W-15B