


ITEM	DESCRIPTION
A	3/8" COPPER OR STAINLESS GOOSE NECK
B	1/2" x 3/8" BRASS OR STAINLESS VALVE
C	1/2" TYPE K SOFT COPPER TUBING
D	1" x 1/2" BRASS BUSHING
E	1" STRAIGHT BRASS COUPLING
F	HOT DIPPED GALVANIZED OR POWDER COATED EPOXY STEEL HOUSING (SUPPLIED BY DSRSD)
G	PEA GRAVEL
H	1" TYPE K COPPER TUBING
I	1/2"Ø WEEP HOLE
J	ANCHOR BOLT
K	FLARE FITTING OR COMPRESSION JOINT
L	CORPORATION STOP (MUELLER 300 SERIES, MCDONALD 4701BQ, OR EQUAL)
M	SERVICE SADDLE – BRONZE (ROCKWELL 323, MUELLER 16100, MCDONALD 3825, OR APPROVED EQUAL)

**NOTES:**

- GRIND ALL CUTS SMOOTH
- PROVIDE NECESSARY CLEARANCE TO ALLOW HASP TO SHUT
- OUTSIDE OF FINISHED STATION TO RECEIVE ONE COAT (SPRAYED OR BRUSHED) OF:
  - RED OXIDE PRIMER
  - OIL BASE HEAVY DUTY INDUSTRIAL GLOSS ENAMEL
- MINIMUM COVER FOR THE SERVICE LINE SHALL BE 36 INCHES.
- MINIMUM BENDING RADIUS FOR COPPER TUBING SHALL BE 8 INCHES.
- SERVICE LINE SHALL REST ON UNDISTURBED EARTH.

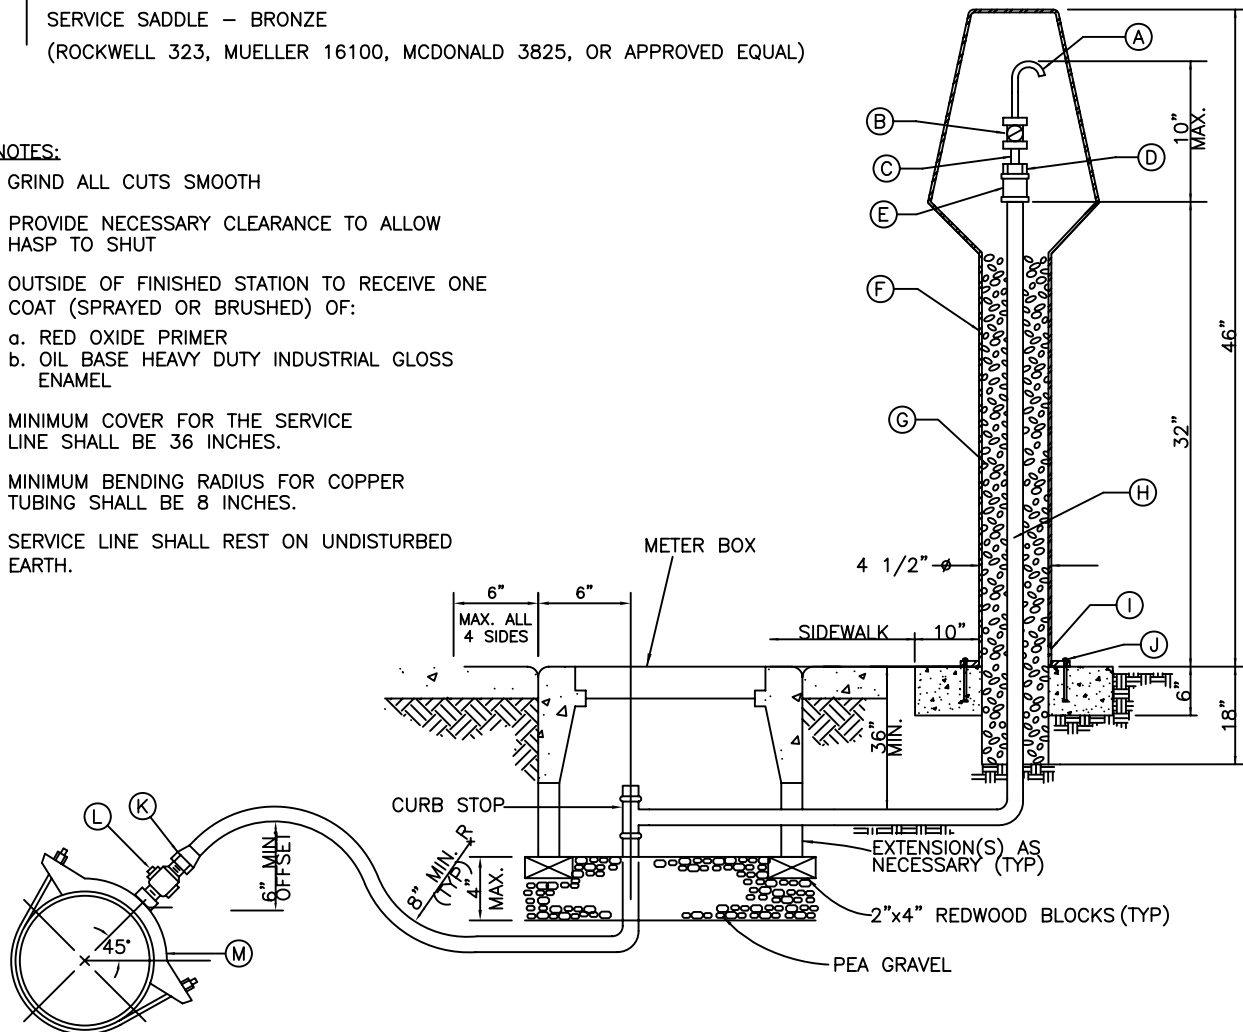

REV. 05/06

Dublin San Ramon Services District

DATE  
JUL 2000

STANDARD  
SAMPLING STATION

DESIGNED  
----

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING  
W-26