


ITEM	DESCRIPTION
A	3/8" STAINLESS GOOSE NECK
B	1/2" x 3/8" BRASS OR STAINLESS VALVE
C	1/2" POLYETHYLENE TUBING
D	1" x 1/2" BRASS BUSHING
E	1" STRAIGHT BRASS COUPLING
F	POWDER COATED EPOXY STEEL HOUSING
G	PEA GRAVEL
H	1" POLYETHYLENE TUBING
I	1/2"Ø WEEP HOLE
J	ANCHOR BOLT
K	FLARE FITTING OR COMPRESSION JOINT
L	CORPORATION STOP (MUELLER 300 SERIES OR EQUAL)
M	SERVICE SADDLE - BRONZE (ROCKWELL 323, MUELLER 16100, OR APPROVED EQUAL)
N	TW #10 TRACER WIRE

NOTES:

- GRIND ALL CUTS SMOOTH
- PROVIDE NECESSARY CLEARANCE TO ALLOW HASP TO SHUT. LOCKS TO BE KEYED TO DISTRICT KEY.
- MINIMUM COVER FOR THE SERVICE LINE SHALL BE 36 INCHES.
- MINIMUM BENDING RADIUS FOR COPPER TUBING SHALL BE 8 INCHES.
- SERVICE LINE SHALL REST ON UNDISTURBED EARTH.

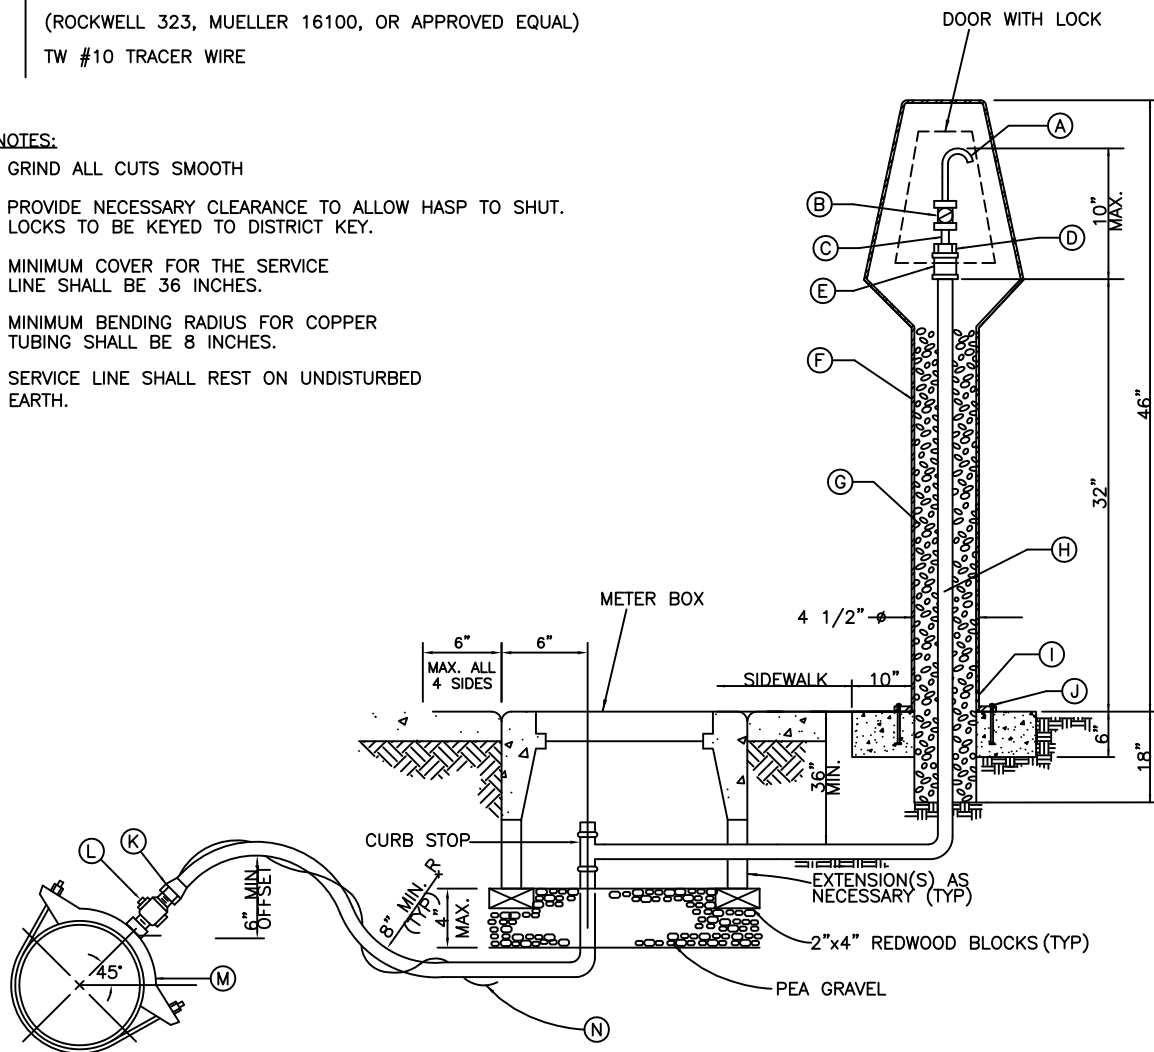

REV. 09/11

Dublin San Ramon Services District

DATE
JUL 2000

STANDARD
SAMPLING STATION

DESIGNED

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING
W-26