


ITEM	DESCRIPTION
A	6" CLOW FH NO. 950 (RESIDENTIAL) OR 960 (COMMERCIAL)
B	6" FH BURY W/ MJ OR HUB INLET
C	6" D.I. PIPE OR C-900 PVC
D	6" FLANGE GV W/ 2" SQ. NUTS
E	BELL X BELL X FLANGE TEE
F	BREAK AWAY BOLTS, NUTS ON TOP FILLED WITH GREASE
G	SQUARE CONCRETE PAD
H	7.5" DIA 1 LB POWDER COATED

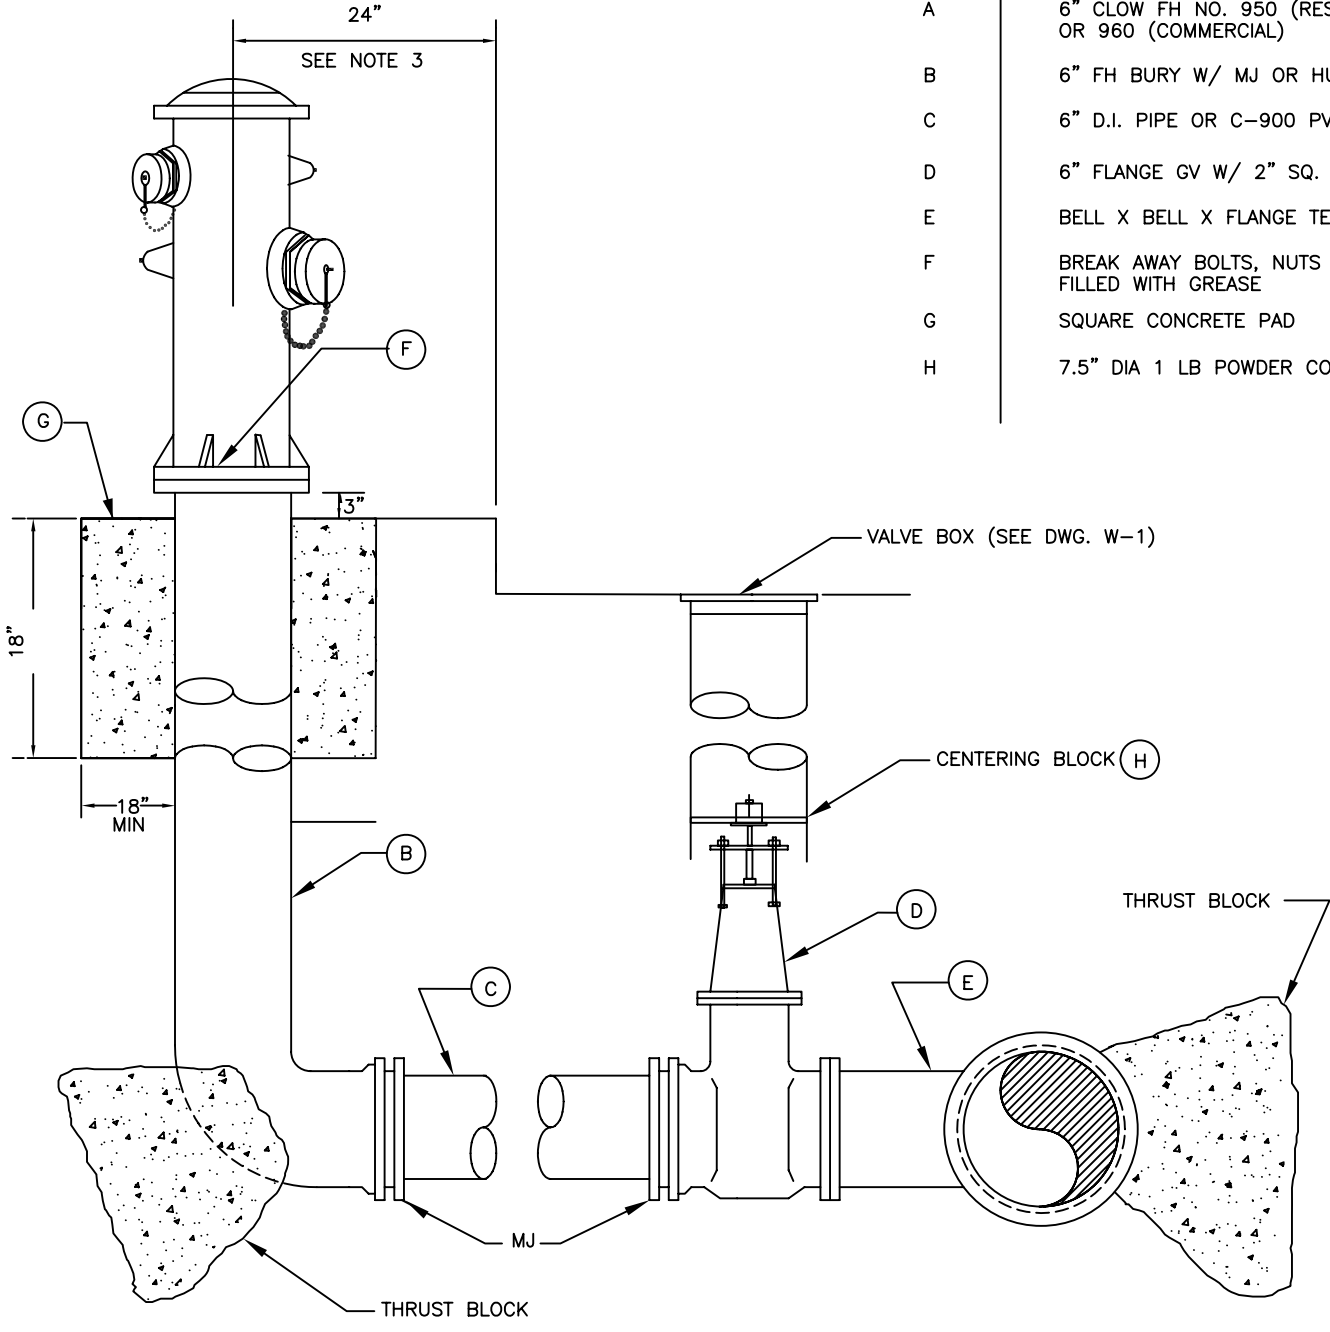

NOTES:

1. ON MAINS WHERE VALVES ARE TO BE INSTALLED ADJACENT TO TEES OR CROSSES, THE VALVES SHALL BE FLANGED X MJ WITH FLANGED END BOLTED DIRECTLY TO THE TEE OR CROSS.
2. VALVE DISTANCE IN FEET TO BE MARKED ON CURB.
3. SEE PLANS AND SPECIFICATIONS FOR LOCATION OF HYDRANTS. REFER TO SECTION II-B2-5.01 FOR PLACEMENT OF FIRE HYDRANTS BEHIND CURBS AND SIDEWALKS.
4. REFER TO SECTION II-B1-2.03 FOR HYDRANT EXTERIOR PAINT REQUIREMENTS.

REV. 01/07

Dublin San Ramon Services District

DATE
MAY 1987

FIRE HYDRANT INSTALLATION

DESIGNED
SAD

SIGNED COPY ON FILE AT DISTRICT OFFICE

DRAWING
W-6