


DUBLIN SAN RAMON SERVICES DISTRICT RECYCLED WATER USE GUIDELINES

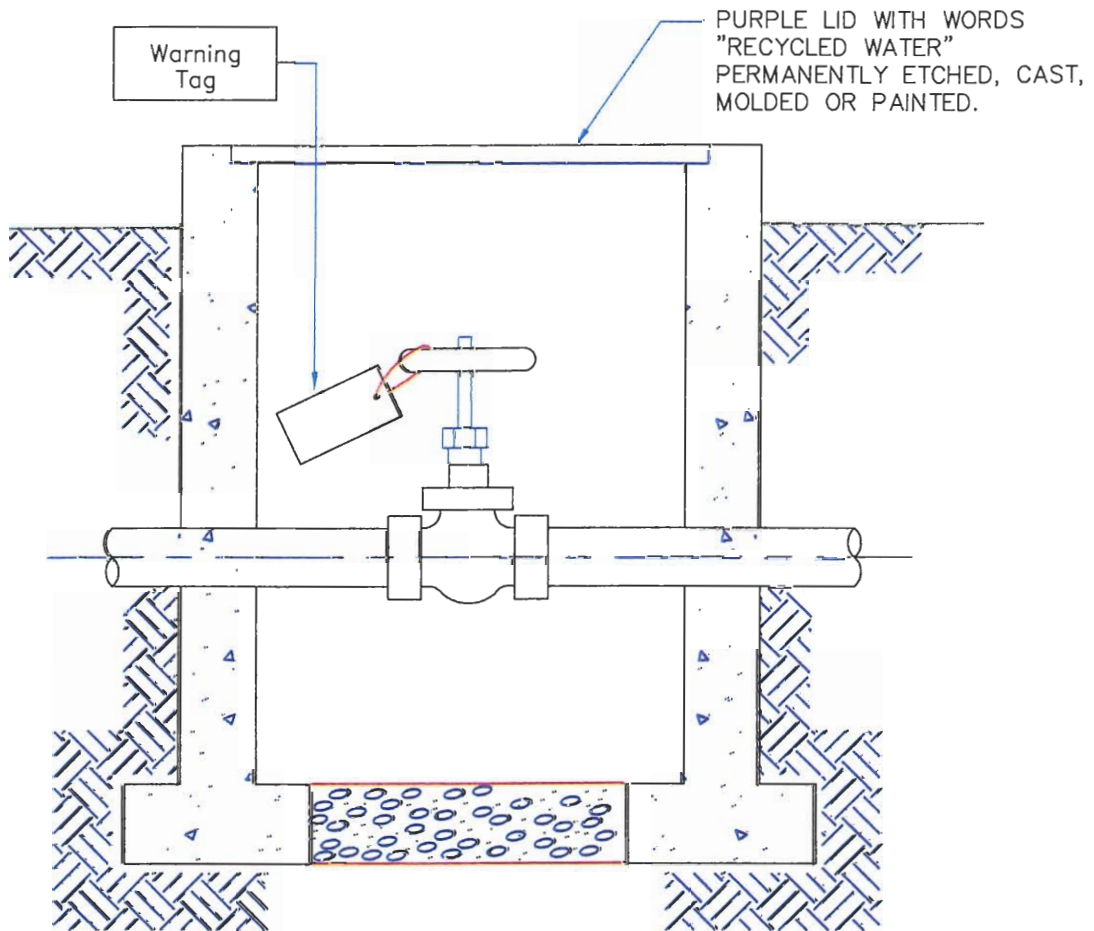

INSTALLATION OF WARNING LABELS AT GATE VALVE

Figure D