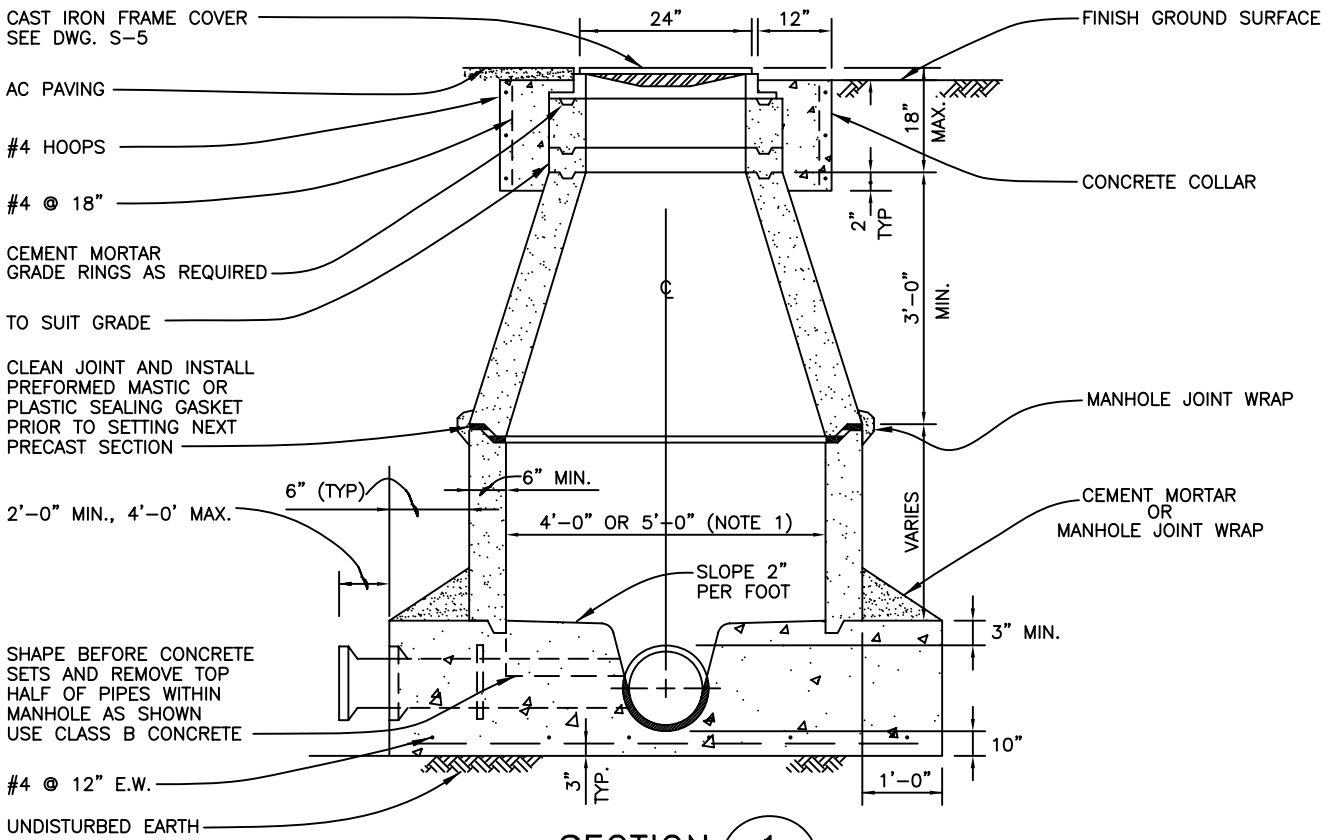

SECTION 1 / ~

NTS

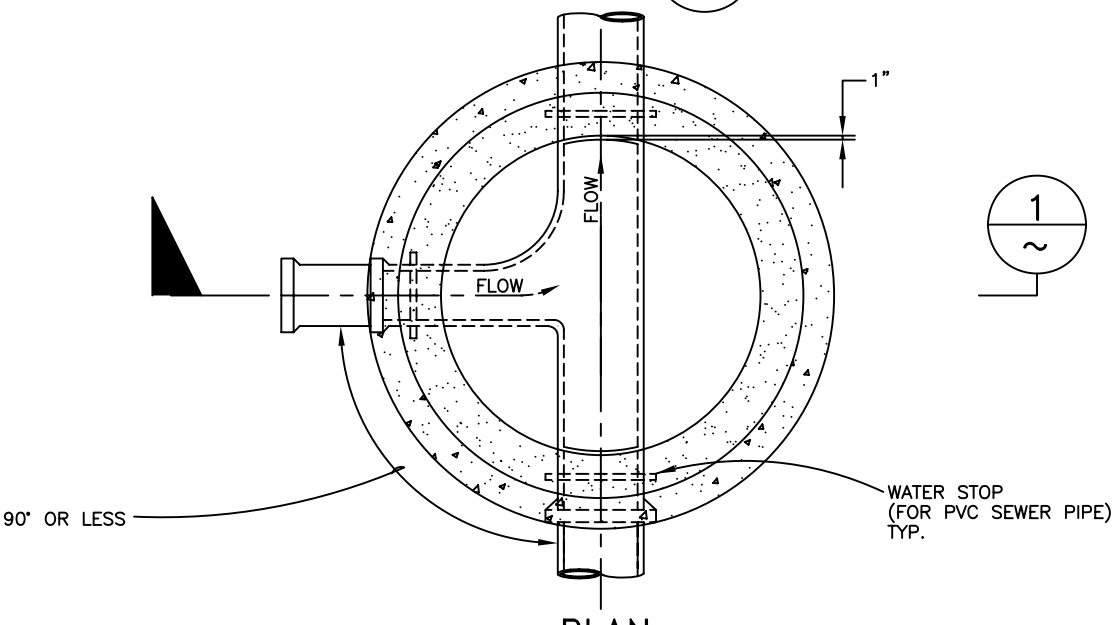

PLAN

NOTES:

1. SEE SPEC. SEC. III-A5-7 FOR CRITERIA ON MANHOLE SIZING. NTS
2. MANHOLE SHALL HAVE NO STEPS.
3. USE RAMNECK OR APPROVED EQUAL BETWEEN JOINTS. TRIM ALL JOINTS AFTER COMPLETION.
4. JOINTS SHALL BE WRAPPED WITH 9-INCH RUB'R-NEK EXTERNAL CONCRETE JOINT WRAP, OR APPROVED EQUAL.
5. ALL PIPES MUST HAVE A JOINT 2'-4' OUT FROM MANHOLE.

REV. 04/07

Dublin San Ramon Services District	DATE MAY 1987
STANDARD MANHOLE	DESIGNED SRH
SIGNED COPY ON FILE AT DISTRICT OFFICE	DRAWING S-2